


Multi-Purpose NEC800      Communica-tions NEC800      Remote Con-trol NEC725      Fire Protection NEC760

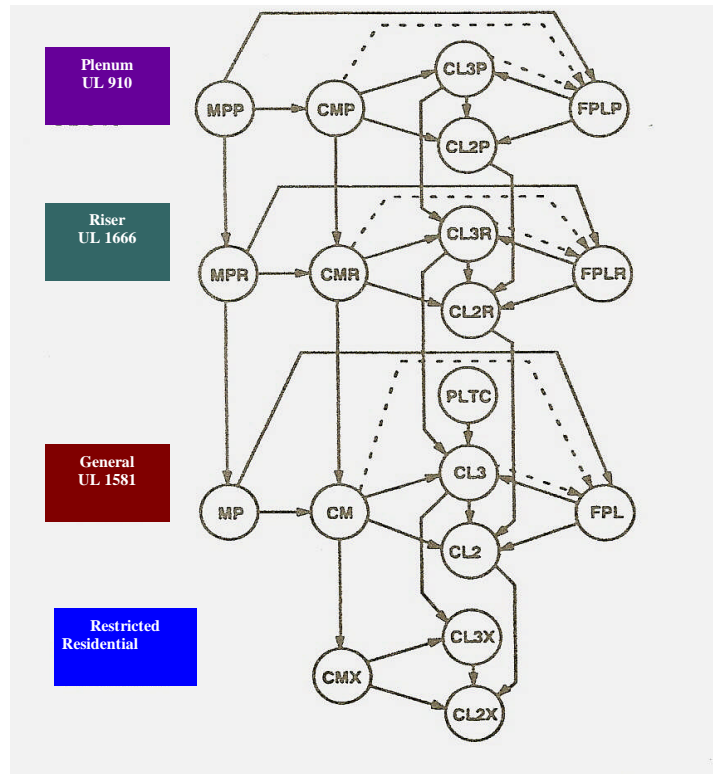

Underwriters Laboratories requires that cables be listed and carry all the necessary cable markings. In each of the NEC Articles under consideration there are 4 important factors:

1. The application governs the cable requirement. For example, Article 760 covers fire protective signaling systems.
1. The code of importance is the one currently approved and in use within the local municipality or state.
2. The local Inspector/Fire Marshall is the ultimate authority to approve or disapprove a cable for the particular installation in accordance with the code in effect.
3. The substitute cable must meet the required electrical characteristics.

**TO ORDER PRODUCT OR SPEAK TO A SALESPERSON CALL  
(CHICAGO) 1-888-888-8045 (HOUSTON) 1-888-880-5054**